


FILE: J:\GIS\Aqua PA\2017 Projects\Mountainhome Main Replacements - Rev 4.4-17.mxd, AUTHOR: ctm, DATE: 4/5/2017

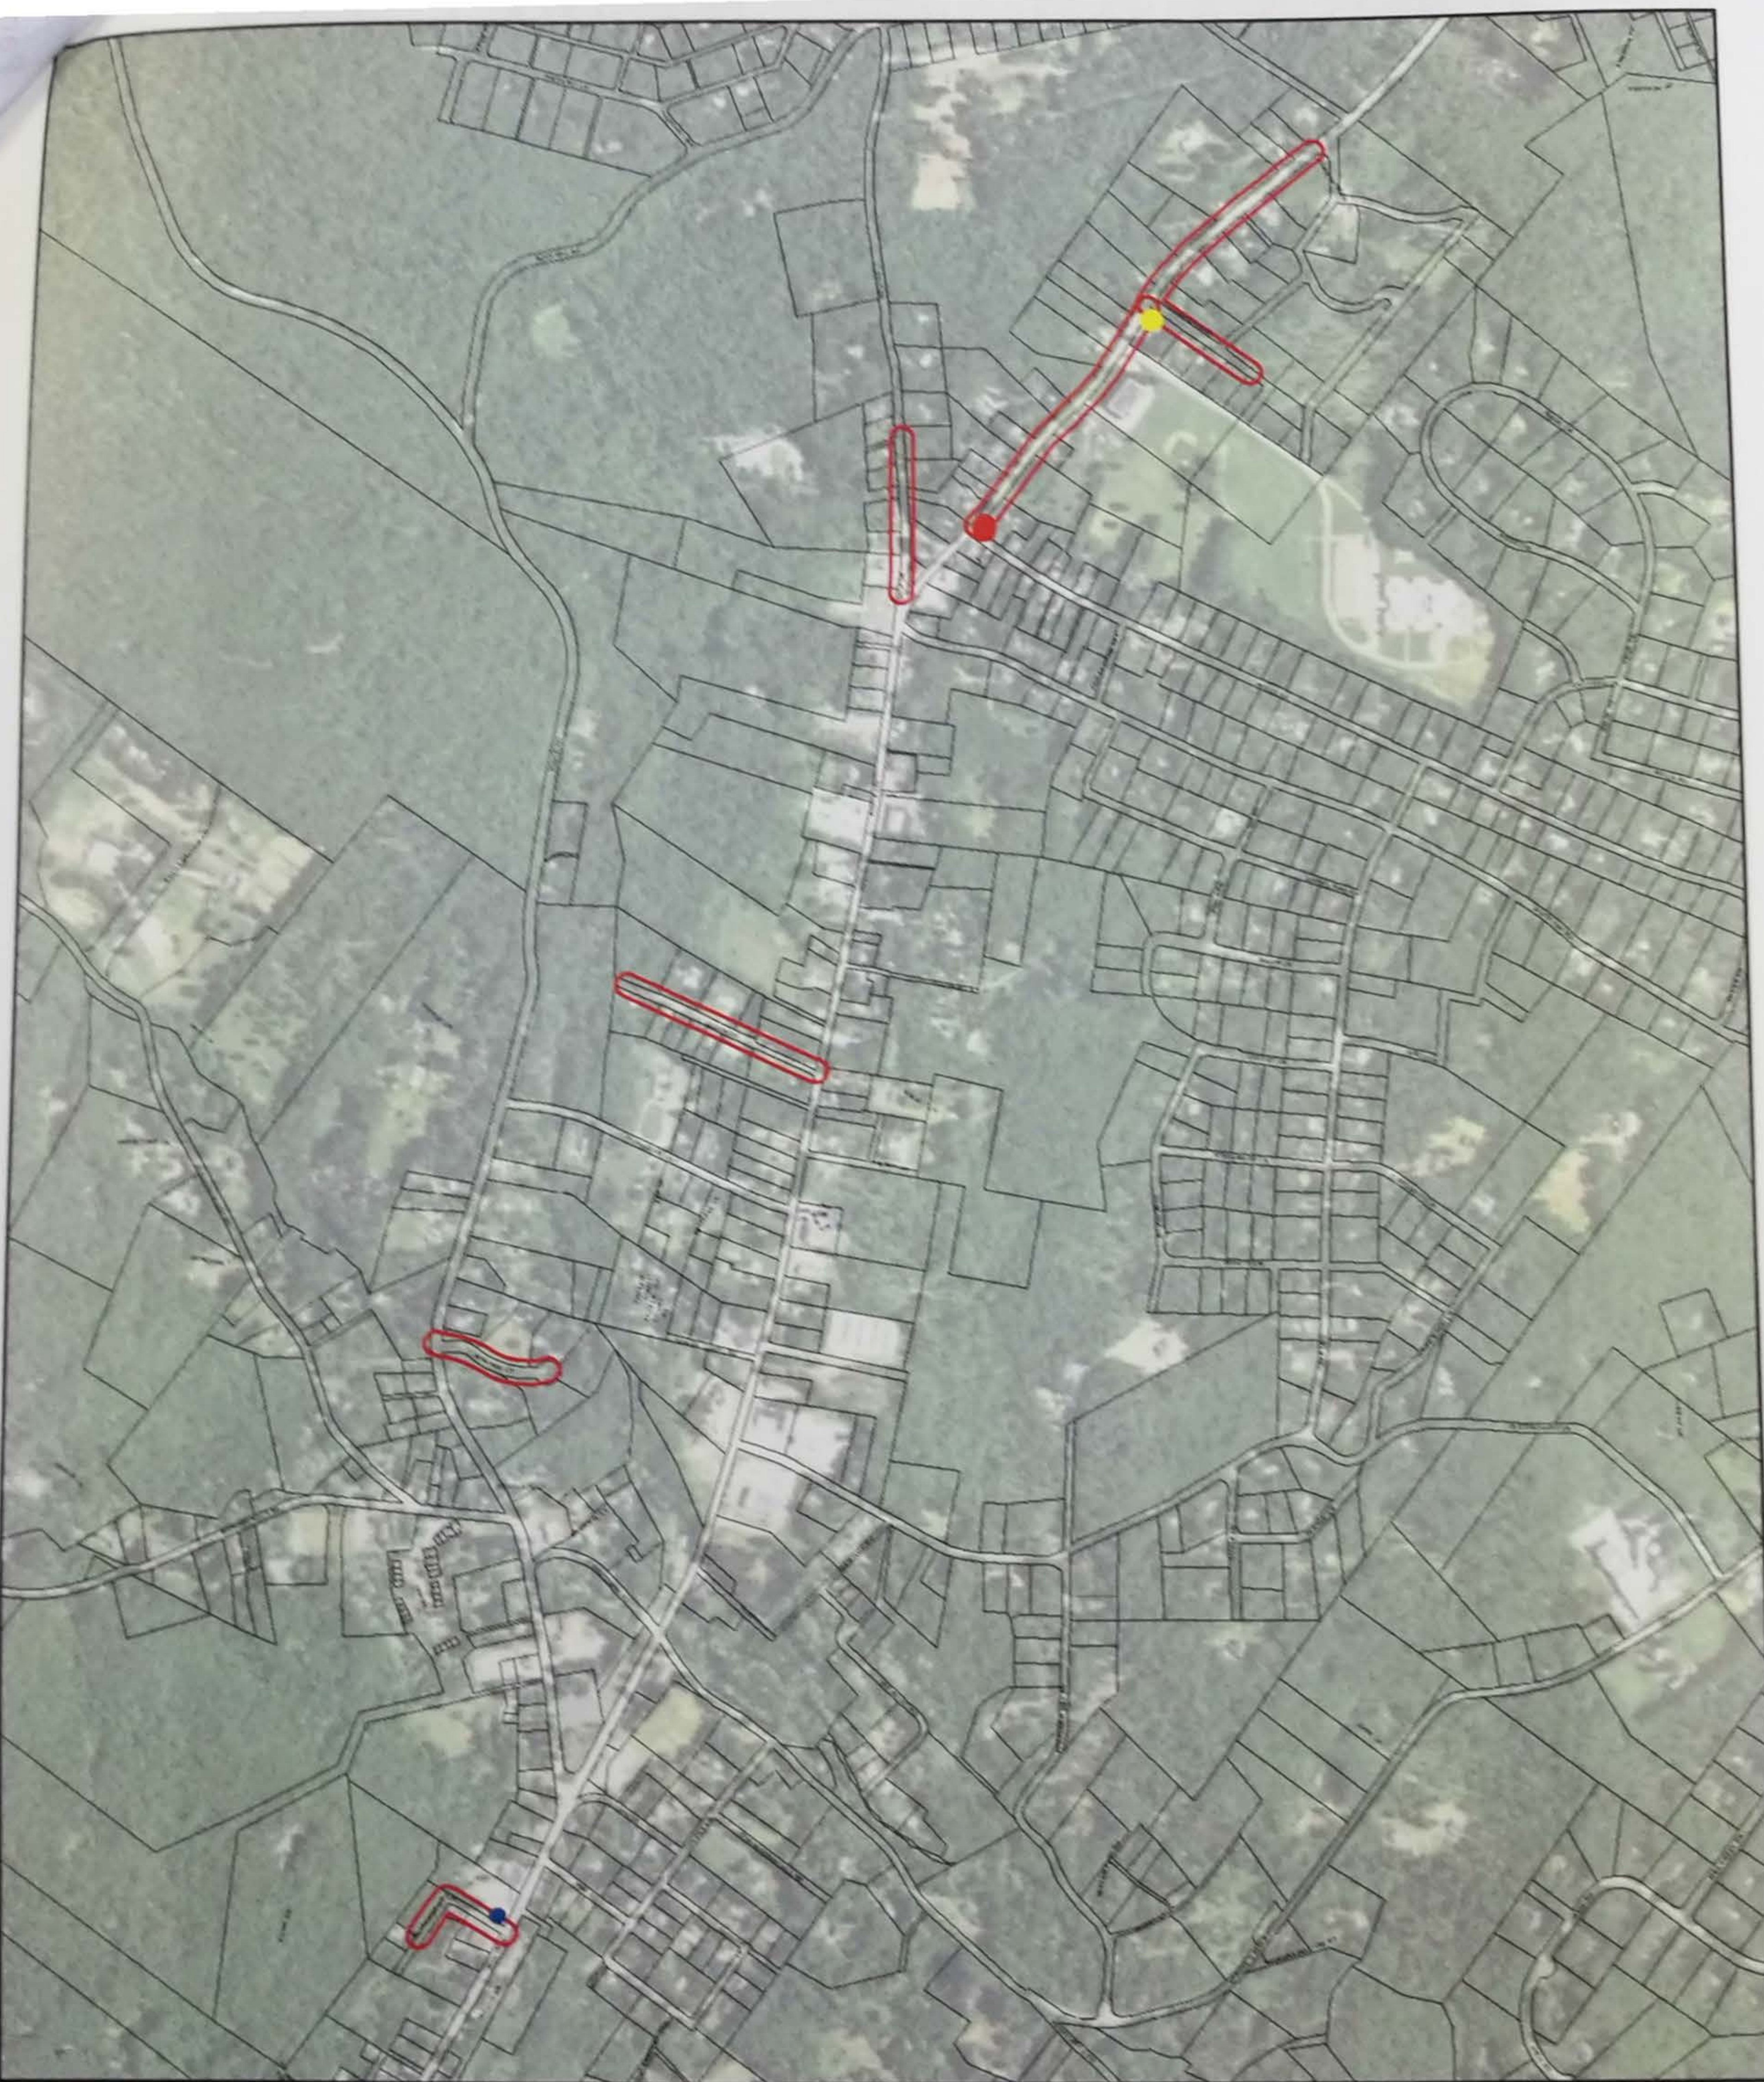

ENTECH
ENGINEERING
1.800.825.1372 | www.entecheng.com

AQUA PENNSYLVANIA, INC.
BARRETT TOWNSHIP, MONROE COUNTY, PA
2017 MAIN REPLACEMENTS
MOUNTAINHOME WATER SYSTEM

GREENE	DATE	PREPARED	CHECKED	PROJECT ENGINEER
BARRETT	04/05/17	CTT	CTT	CTT
PARADISE	PROJECT	SCALE	DRAWING NO.	
PRICE	5511.27	1" = 1000'	EXH-1	

Pam Gardsy

From: Brick Linder <brickt@ptd.net>
Sent: Friday, June 02, 2017 11:38 AM
To: Pam Gardsy
Cc: Grover Cleveland; Benjie Labar; Bill Pipolo; btwpmainSuper; GuthrieSuper; MegliolaSuper
Subject: FW: Aqua PA - Mountainhome Water System - Fire Hydrants
Attachments: Mountainhome Main Replacements - Rev 4-4-17 170510.pdf

Pam,

In April, Entech reached out to me regarding fire hydrant locations for their 2018 water main replacement project. I reviewed the layout with our officers, and we recommended the following:

- The existing FH in front of the previous Barrett school be eliminated, as the school was removed.
- Install a new FH at the southerly corner of the intersection of Route 390 and Thompson Way (yellow in the attached). This FH is essentially be a relocation of the Barrett school FH and will provide us with water for the houses along Thompson Way and further north along Route 390.
- Install a new FH along Hummingbird Lane & Route 390, between Mick Motors and the Lewcor building. That FH would provide us water to protect Mick Motors, TB Price and the Lewcor building.

I provided this information to Entech, and they are now requesting that the township provide a letter with these requests. See yellow. Could you request the BOS review these locations, and provide the requested letter. If anyone has any questions, please either contact me by email or phone.

Thanks for your help.

-Brick

From: Curtis Tran [mailto:CTran@entecheng.com]
Sent: Wednesday, May 31, 2017 11:18 AM
To: Brick Linder <brickt@ptd.net>
Cc: 'Shoff, Joshua P.' <JPShoff@aquaamerica.com>; 'Freethy, Nicholas E.' <NEFreethy@aquaamerica.com>; Dan J. Hopkins, Jr <DHopkins@entecheng.com>
Subject: RE: Aqua PA - Mountainhome Water System - Fire Hydrants

Mr. Linder, Aqua has verified that the hydrant at Price's Drive and 390 is fully operational. So, it will not be replaced as part of this project. Since Barrett Township is billed for the hydrants, Aqua will require a letter from

